



**20/25mm COMMERCIAL/INDUSTRIAL
WATER METER NO FIRE HOSE REELS LOW
TO MEDIUM BACKFLOW HAZARD RATING**

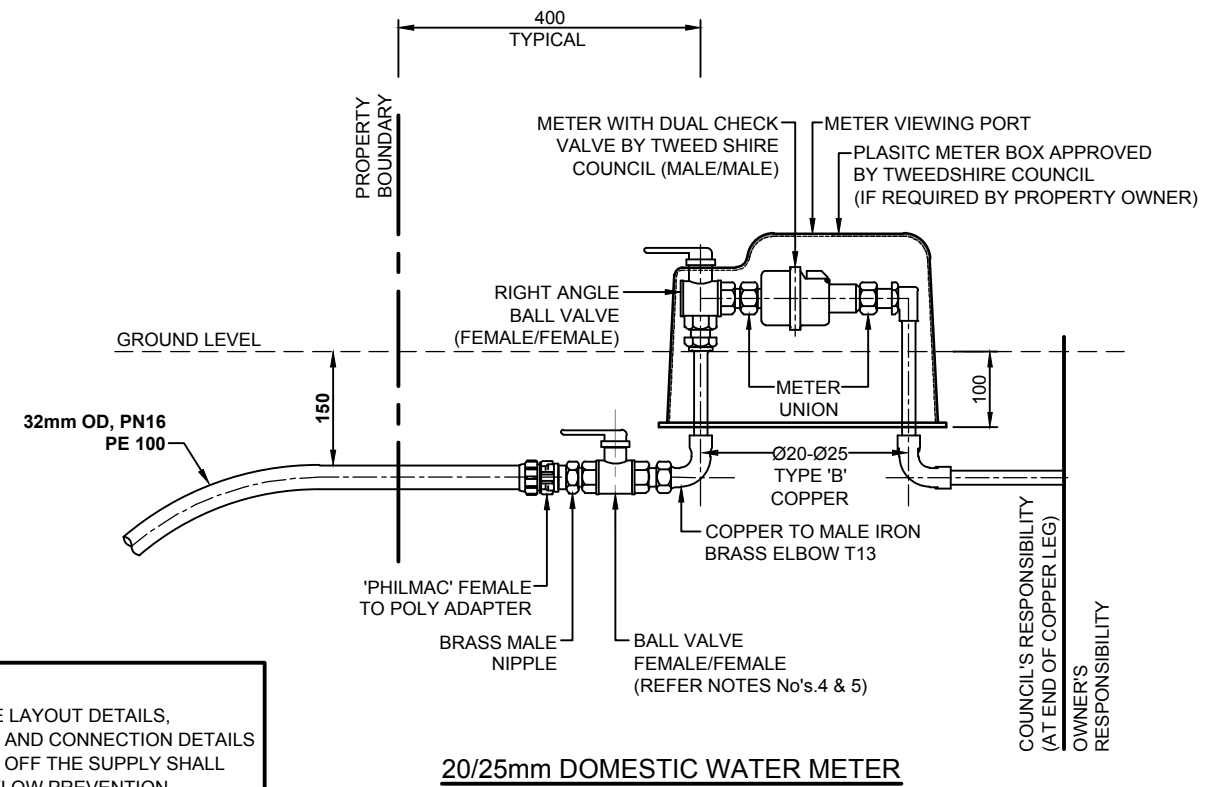


20/25mm DOMESTIC WATER METER


- NOTES:**
- REFER S.D. 302 FOR SERVICE LAYOUT DETAILS, SERVICE CONDUITS DETAILS AND CONNECTION DETAILS
 - ANY IRRIGATION LINE TAKEN OFF THE SUPPLY SHALL REQUIRE ADDITIONAL BACKFLOW PREVENTION DEVICES INSTALLED AT TAKE OFF POINT
 - TEMPORARY SUPPORT FOR METER INSTALLATION TO BE PROVIDED PRIOR TO PRIVATE PLUMBERS CONNECTION
 - THE BRASS BALL VALVE MAY BE EITHER A FEMALE/FEMALE WITH A BRASS MALE NIPPLE OR MALE/FEMALE WITH NO MALE NIPPLE SUCH AS 'ZETCO' WATERMARKED BALL VALVE SERIES 1231 MALE/TOF PE WITH DZR BRASS LEVER HANDLE (REFER TO DETAIL BELOW)
 - BALL VALVE TO BE INSTALLED AT END OF LINE ONLY WHEN THERE IS A TIME LAG BETWEEN CONSTRUCTION OF THE PIPE TO THE BOUNDARY & THE INSTALLATION OF THE METER.

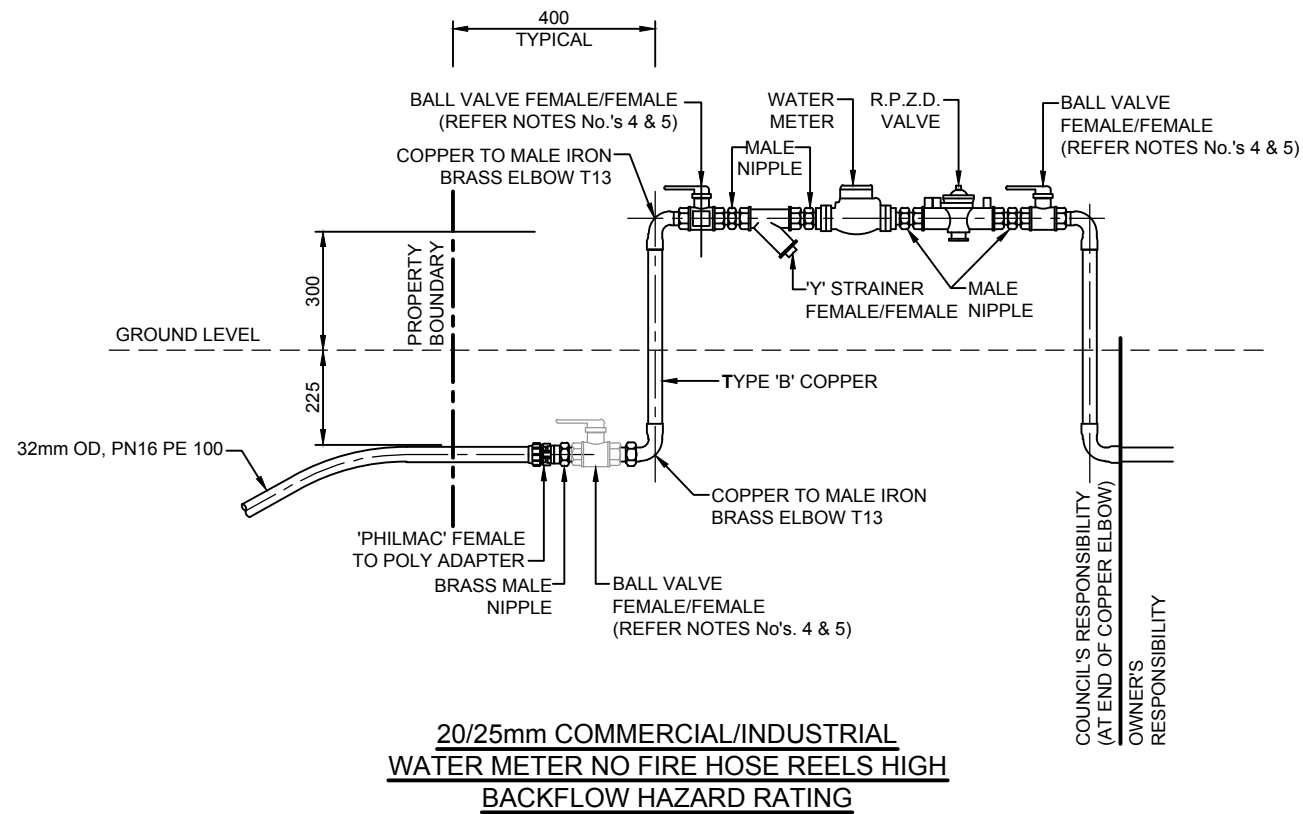

**20/25mm COMMERCIAL/INDUSTRIAL
WATER METER NO FIRE HOSE REELS HIGH
BACKFLOW HAZARD RATING**

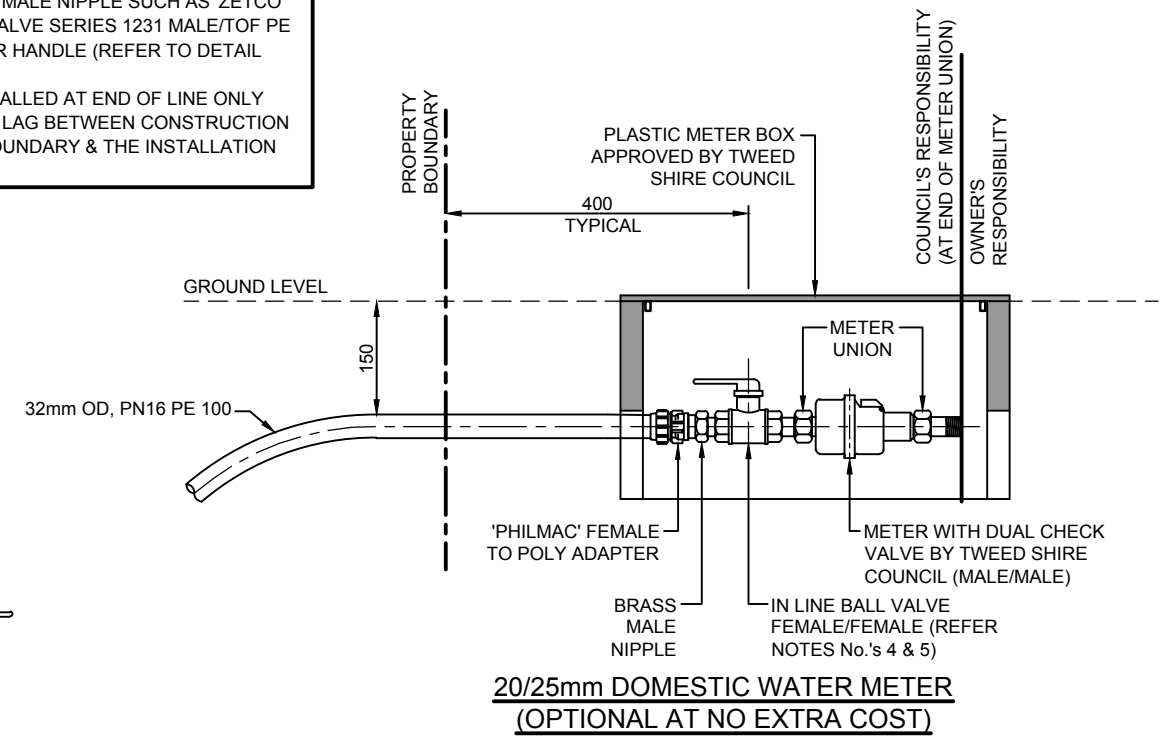

**20/25mm DOMESTIC WATER METER
(OPTIONAL AT NO EXTRA COST)**



DETAIL - MALE/FEMALE BALL VALVE

B	NEW DOMESTIC METER BOX & BALL VALVE FORMAT, NOTES AMENDED & PLAN FORM UPGRADED	G.P.C.	06.2015
A	ORIGINAL ISSUE	J.P.	05.2006
ISSUE	AMENDMENT DETAILS	INITIALS	DATE



DESIGN UNIT
COUNCIL OFFICES
TUMBULGUM ROAD,
MURWILLUMBAH,
NEW SOUTH WALES 2464
PHONE 02 6670 2400
FAX 02 6672 7513
WEBSITE www.tweed.nsw.gov.au

DESIGN ENGINEER	<i>Ahu</i>	DATE 11.05.15
DESIGN MANAGER	<i>P. May</i>	DATE 22.05.15
DRAWN	ENGINEERING & OPERATIONS DESIGN UNIT	
SCALE	NOT TO SCALE	

PROJECT:	WATER SUPPLY STANDARDS
PLAN TITLE:	DN20 & DN25 PROPERTY SERVICE DETAILS

DRAWING NUMBER:	S.D. 321
	JUNE 2015

0 10 20 30 40 50 100 150 200 250

ACAD FILE No: G:_AAA TSC STANDARD DRAWINGS\300 WATER SUPPLY\S.D.321 (June-15 Rev B).dwg