


PLAN

FITTING SCHEDULE		
ITEM	DESCRIPTION	No
1	EXISTING COUNCIL WATER MAIN	
2	MULTIFIT GIBAULT FBN COATED WITH S/S NUTS & BOLTS	2
3	DICL TEE SP/SP/FL	1
4	SLUICE VALVE FL/FL, RESILIENT SEATED, FBN COATED	3
5	DICL PIPE, DN 100 MINIMUM	
6	DICL TEE FL/FL/FL	1
7	DICL PIPE PIECE FL/FL	4
8	DICL 90° BEND FL/FL	9
9	LINE STRAINER	1
10	KENT 3000V COMBINATION METER	1
11	DOUBLE CHECK VALVE	1
12	FIRELINE DOUBLE DETECTOR CHECK VALVE (35Kpa 1ST CHECK ASSEMBLY)	1
13	DICL PIPE PIECE FL/FL 300mm LONG	1
14	40mm DOUBLE CHECK VALVE	1
15	40mm BALL VALVE	2
16	40mm 'Y' STRAINER	1
17	40mm WATER METER	1
18	40mm TYPE 'A' COPPER TUBE	
19	RISING SPINDLE SLUICE VALVE FL/FL, RESILIENT SEATED, FBN COATED	2

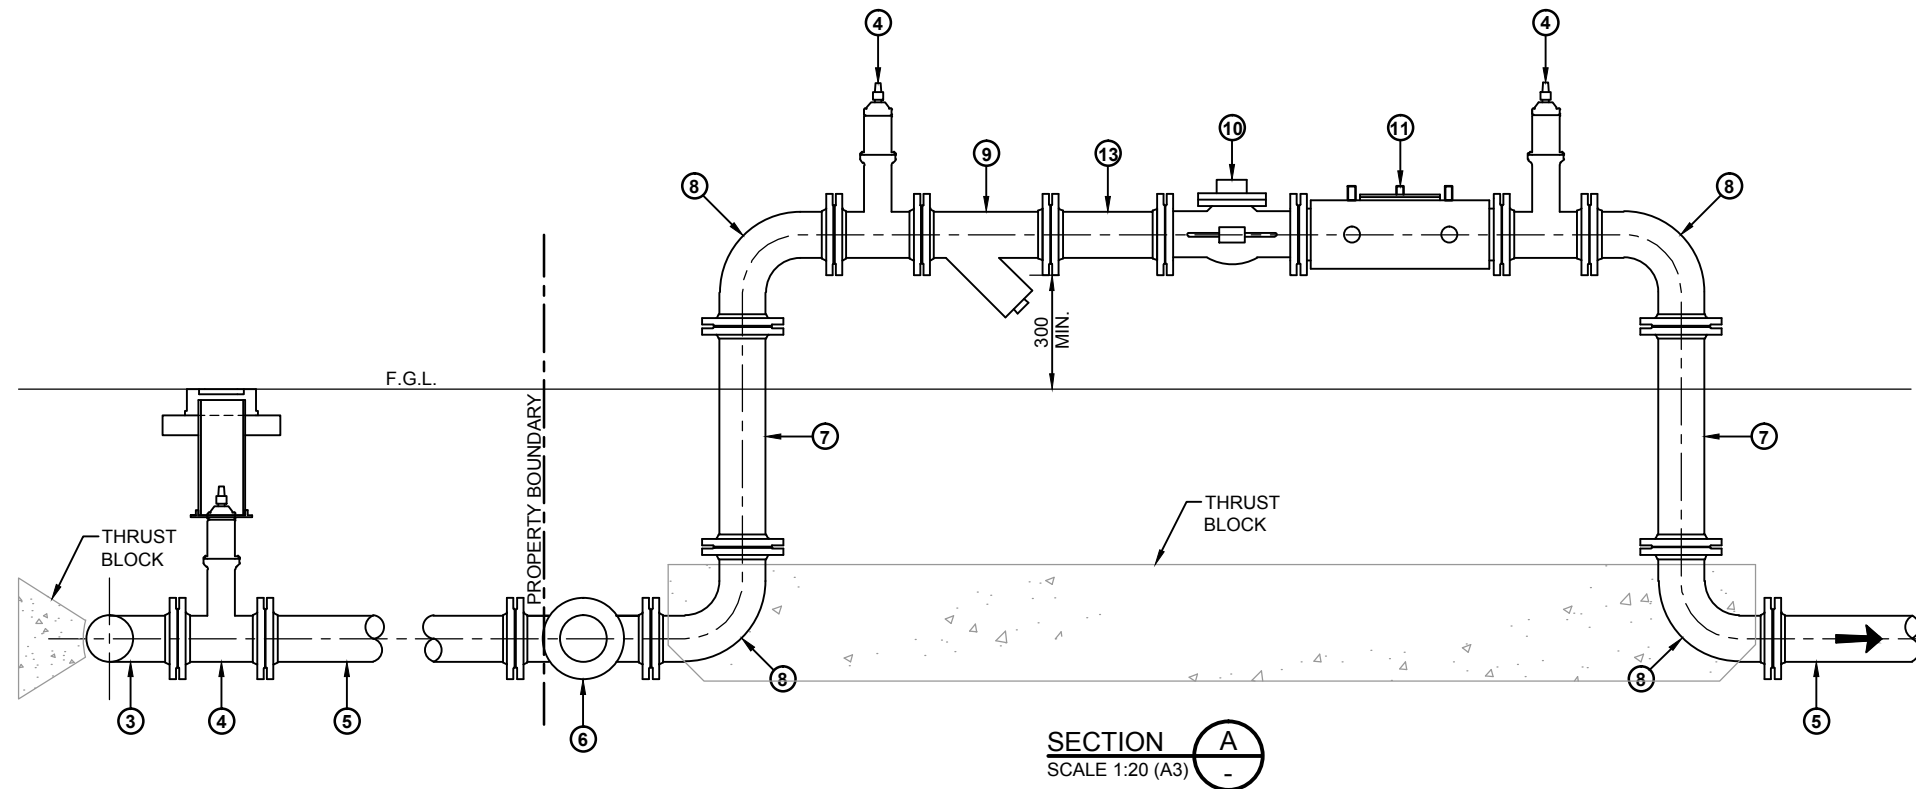

SECTION A
SCALE 1:20 (A3)

- NOTES:**
1. ANY IRRIGATION TAKEN OFF THE DOMESTIC SERVICE SHALL REQUIRE AN ADDITIONAL BACKFLOW PREVENTION DEVICE TO BE INSTALLED AT TAKE OFF POINT.
 2. ALL PIPE FITTINGS TO COMPLY WITH TWEED SHIRE COUNCIL SUPPLY CONTRACT SPECIFICATION, REFER TO STANDARD DRAWING S.D. 322.
 3. CONTRACTOR SHALL BE RESPONSIBLE FOR CHECKING PIPE LENGTHS AND FITTINGS TO ENSURE CONSTRUCTABILITY PRIOR TO ORDERING PIPES AND FITTINGS.
 4. LOCKED CHAIN TO BE INSTALLED ON VALVES WITH TSC 888 PADLOCK.

ISSUE	AMENDMENT DETAILS	INITIALS	DATE
B	NOTES AMENDED & PLAN FORM UPGRADED	G.P.C.	06.2015
A	ORIGINAL ISSUE	J.P.	05.2006




DESIGN UNIT
 COUNCIL OFFICES
 TUMBULGUM ROAD,
 MURWILLUMBAH,
 NEW SOUTH WALES 2484
 PHONE 02 6670 2400
 FAX 02 6672 7513
 WEBSITE www.tweed.nsw.gov.au

DESIGN ENGINEER	<i>Alan</i>	DATE 11.05.15
DESIGN MANAGER	<i>P. May</i>	DATE 22.05.15
DRAWN	ENGINEERING & OPERATIONS DESIGN UNIT	
SCALE	AS SHOWN	

PROJECT:	WATER SUPPLY STANDARDS
PLAN TITLE:	DN100 OR LARGER PROPERTY SERVICE WITH DN100 OR LARGER SEPARATE FIRE SERVICE

DRAWING NUMBER:	S.D. 325
	JUNE 2015



ACAD FILE No: G:_AAA TSC STANDARD DRAWINGS\300 WATER SUPPLY\S.D.325 (June-15 Rev B).dwg