


PLAN

FITTING SCHEDULE		
ITEM	DESCRIPTION	No
1	EXISTING COUNCIL WATER MAIN	
2	MULTIFIT GIBALUT FBN COATED WITH S/S NUTS & BOLTS	2
3	DICL TEE SP/SP/FL	1
4	SLUICE VALVE FL/FL, RESILIENT SEATED, FBN COATED	1
5	DICL PIPE, DN 100 MINIMUM	
6	DICL 90° BEND FL/FL	4
7	SINGLE DETECTOR CHECK VALVE WITH 20mm LOW FLOW BY-PASS	1
8	DICL PIPE PIECE FL/FL	2
9	RISING SPINDLE SLUICE VALVE FL/FL, RESILIENT SEATED, FBN COATED	1

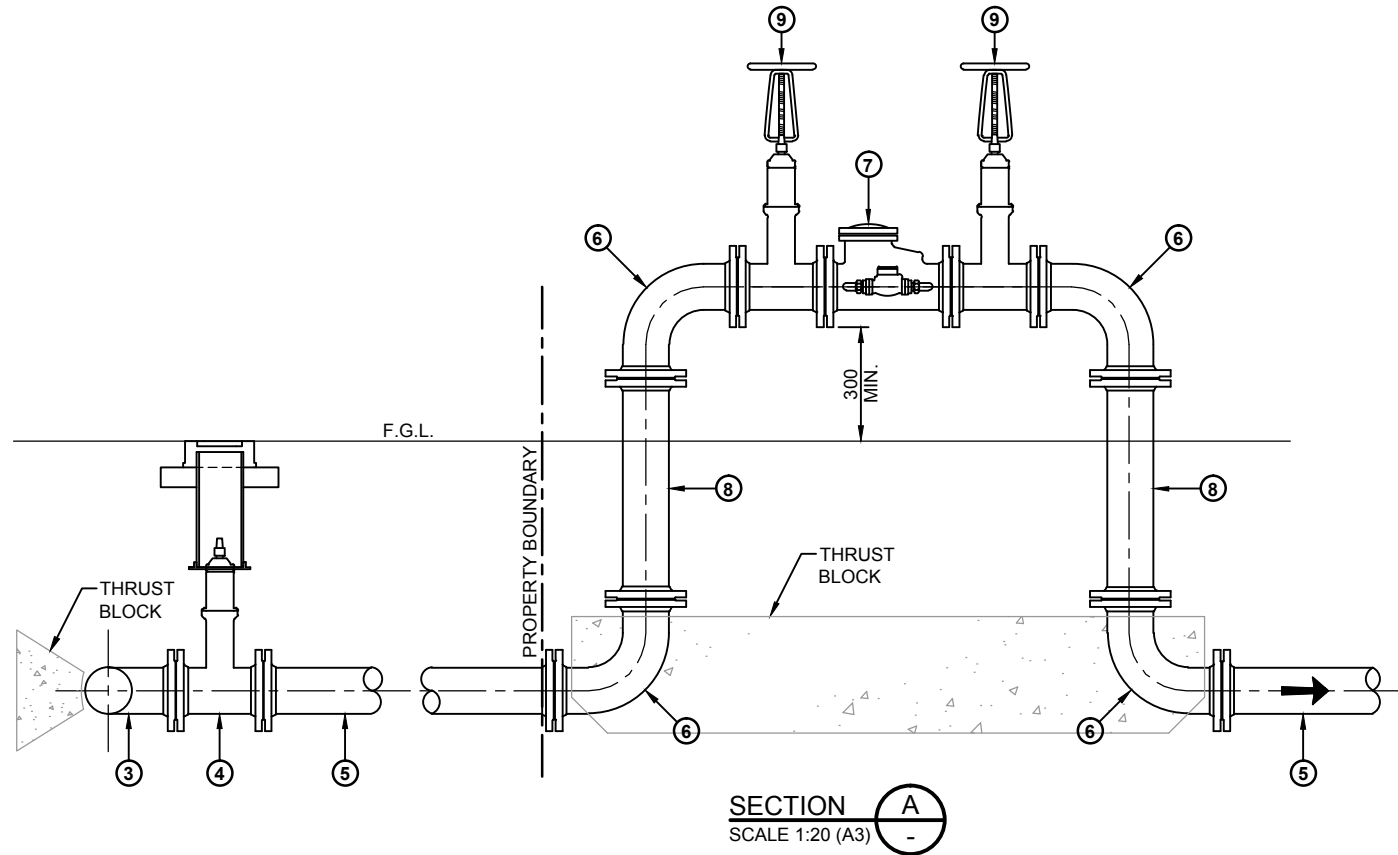

SECTION A-A
SCALE 1:20 (A3)

- NOTES:**
- ANY IRRIGATION TAKEN OFF THE DOMESTIC SERVICE SHALL REQUIRE AN ADDITIONAL BACKFLOW PREVENTION DEVICE TO BE INSTALLED AT TAKE OFF POINT
 - ALL PIPE FITTINGS TO COMPLY WITH TWEED SHIRE COUNCIL SUPPLY CONTRACT SPECIFICATION. REFER TO STANDARD DRAWING S.D. 322.
 - CONTRACTOR SHALL BE RESPONSIBLE FOR CHECKING PIPE LENGTHS AND FITTINGS TO ENSURE CONSTRUCTABILITY PRIOR TO ORDERING PIPES AND FITTINGS
 - LOCKED CHAIN TO BE INSTALLED ON VALVES WITH TSC 55888 PADLOCK

ISSUE	AMENDMENT DETAILS	INITIALS	DATE
B	NOTES AMENDED & PLAN FORM UPGRADED	G.P.C.	06.2015
A	ORIGINAL ISSUE	J.P.	05.2006




DESIGN UNIT
 COUNCIL OFFICES
 TUMBULGUM ROAD,
 MURWILLUMBAH,
 NEW SOUTH WALES 2464
 PHONE 02 6670 2400
 FAX 02 6672 7513
 WEBSITE www.tweed.nsw.gov.au

DESIGN ENGINEER	<i>John</i>	DATE 11.05.15
DESIGN MANAGER	<i>P. May</i>	DATE 22.05.15
DRAWN	ENGINEERING & OPERATIONS DESIGN UNIT	
SCALE	AS SHOWN	

PROJECT:	WATER SUPPLY STANDARDS
PLAN TITLE:	DN100 OR LARGER FIRE SPRINKLER SERVICE

DRAWING NUMBER:	S.D. 327
	JUNE 2015



ACAD FILE No: G:_AAA TSC STANDARD DRAWINGS\300 WATER SUPPLY\S.D.327 (June-15 Rev B).dwg